


LUMINAIRE SCHEDULE										
TYPE	DESCRIPTION	MANUFACTURER	MODEL	HOUSING/ MOUNTING	LAMP TYPE	BALLAST/DRIVER	COMMENTS	VOLTS	INPUT WATTS	QUANTITY
A1	PENDANT	KICHLER	EVERLY 42046-OZ-1 (OLD BRONZE)	SUSPENDED	(1) 60W S21	N/A	SEE NOTE 1	120	60	1
A2	PENDANT	KICHLER	MISSOULA 78200-LT-1 (BRONZE)	SUSPENDED	SATCO S9578	N/A	SEE NOTE 1	120	60	3
C1	LED DOWNLIGHT	CREE	CR6T-825-35K-12-E26GU24	RECESSED	LED ENGINE	LED DRIVER	WHITE TRIM RING	120	12	39
C3	LED CYLINDER	LITHONIA	LDN6-27/15-L06-BR-LD-MVOLT-GZ10-PM-DBL	RECESSED	LED ENGINE	LED DRIVER	BLACK	120	20.5	4
F2	2X4 LED TROFFER	LITHONIA	ZR24-40L-40K-10V	RECESSED	LED ENGINE	LED DRIVER		120	44	14
W1	INTERIOR SCENCE	TECH	700BCLYNNWZ	WALL	N/A	N/A	SEE NOTE 1	120	40	2
W2	EXTERIOR UP/DOWN SCENCE	LITHONIA	OLLWU-WH	WALL	LED DRIVER	LED DRIVER		120	14	8
W3	EXTERIOR WALL SCENCE	RAB LIGHTING	SLIM12W-WHITE	WALL	LED DRIVER	LED DRIVER	-	120	12	8
WP1	EXTERIOR WALL PACK	GENERAL ELECTRIC	EWS30E3E1401DKBZ	WALL	LED DRIVER	LED DRIVER	-	120	90	1
EX1	COMBINATION EMERGENCY EXIT SIGN	LITHONIA	ECR-LED-HO-M6	UNIVERSAL	N/A	N/A	PENDANT MOUNTED AT 10'-0" AFF	120	3.3	2
EX2	COMBINATION EMERGENCY EXIT SIGN	LITHONIA	ECR-LED-HO-M6	UNIVERSAL	N/A	N/A		120	3.3	1
EM1	EMERGENCY BATTERY PACK WITH DUAL HEADS	NAVILITE	LED 90	WALL	N/A	N/A	-	120	10.8	7
EM2	EMERGENCY WP REMOTE TWIN HEAD	LITHONIA	ELAT-6CS-WP-M12	WALL	N/A	N/A	TWIN HEADS	120	7.2	2

NOTES:

Call National Account Representative Mr. Kevin Price, E. Sam Jones 1-800-624-9849 for ordering.

Call National Account Hermitage Lighting for ordering: (800) 264-3383 or email Lindsey Sanders lsanders@hermitagelighting.com

Call National Account, Regency Lighting for ordering: (800) 284-2024 x5100 or arbys@regencylighting.com

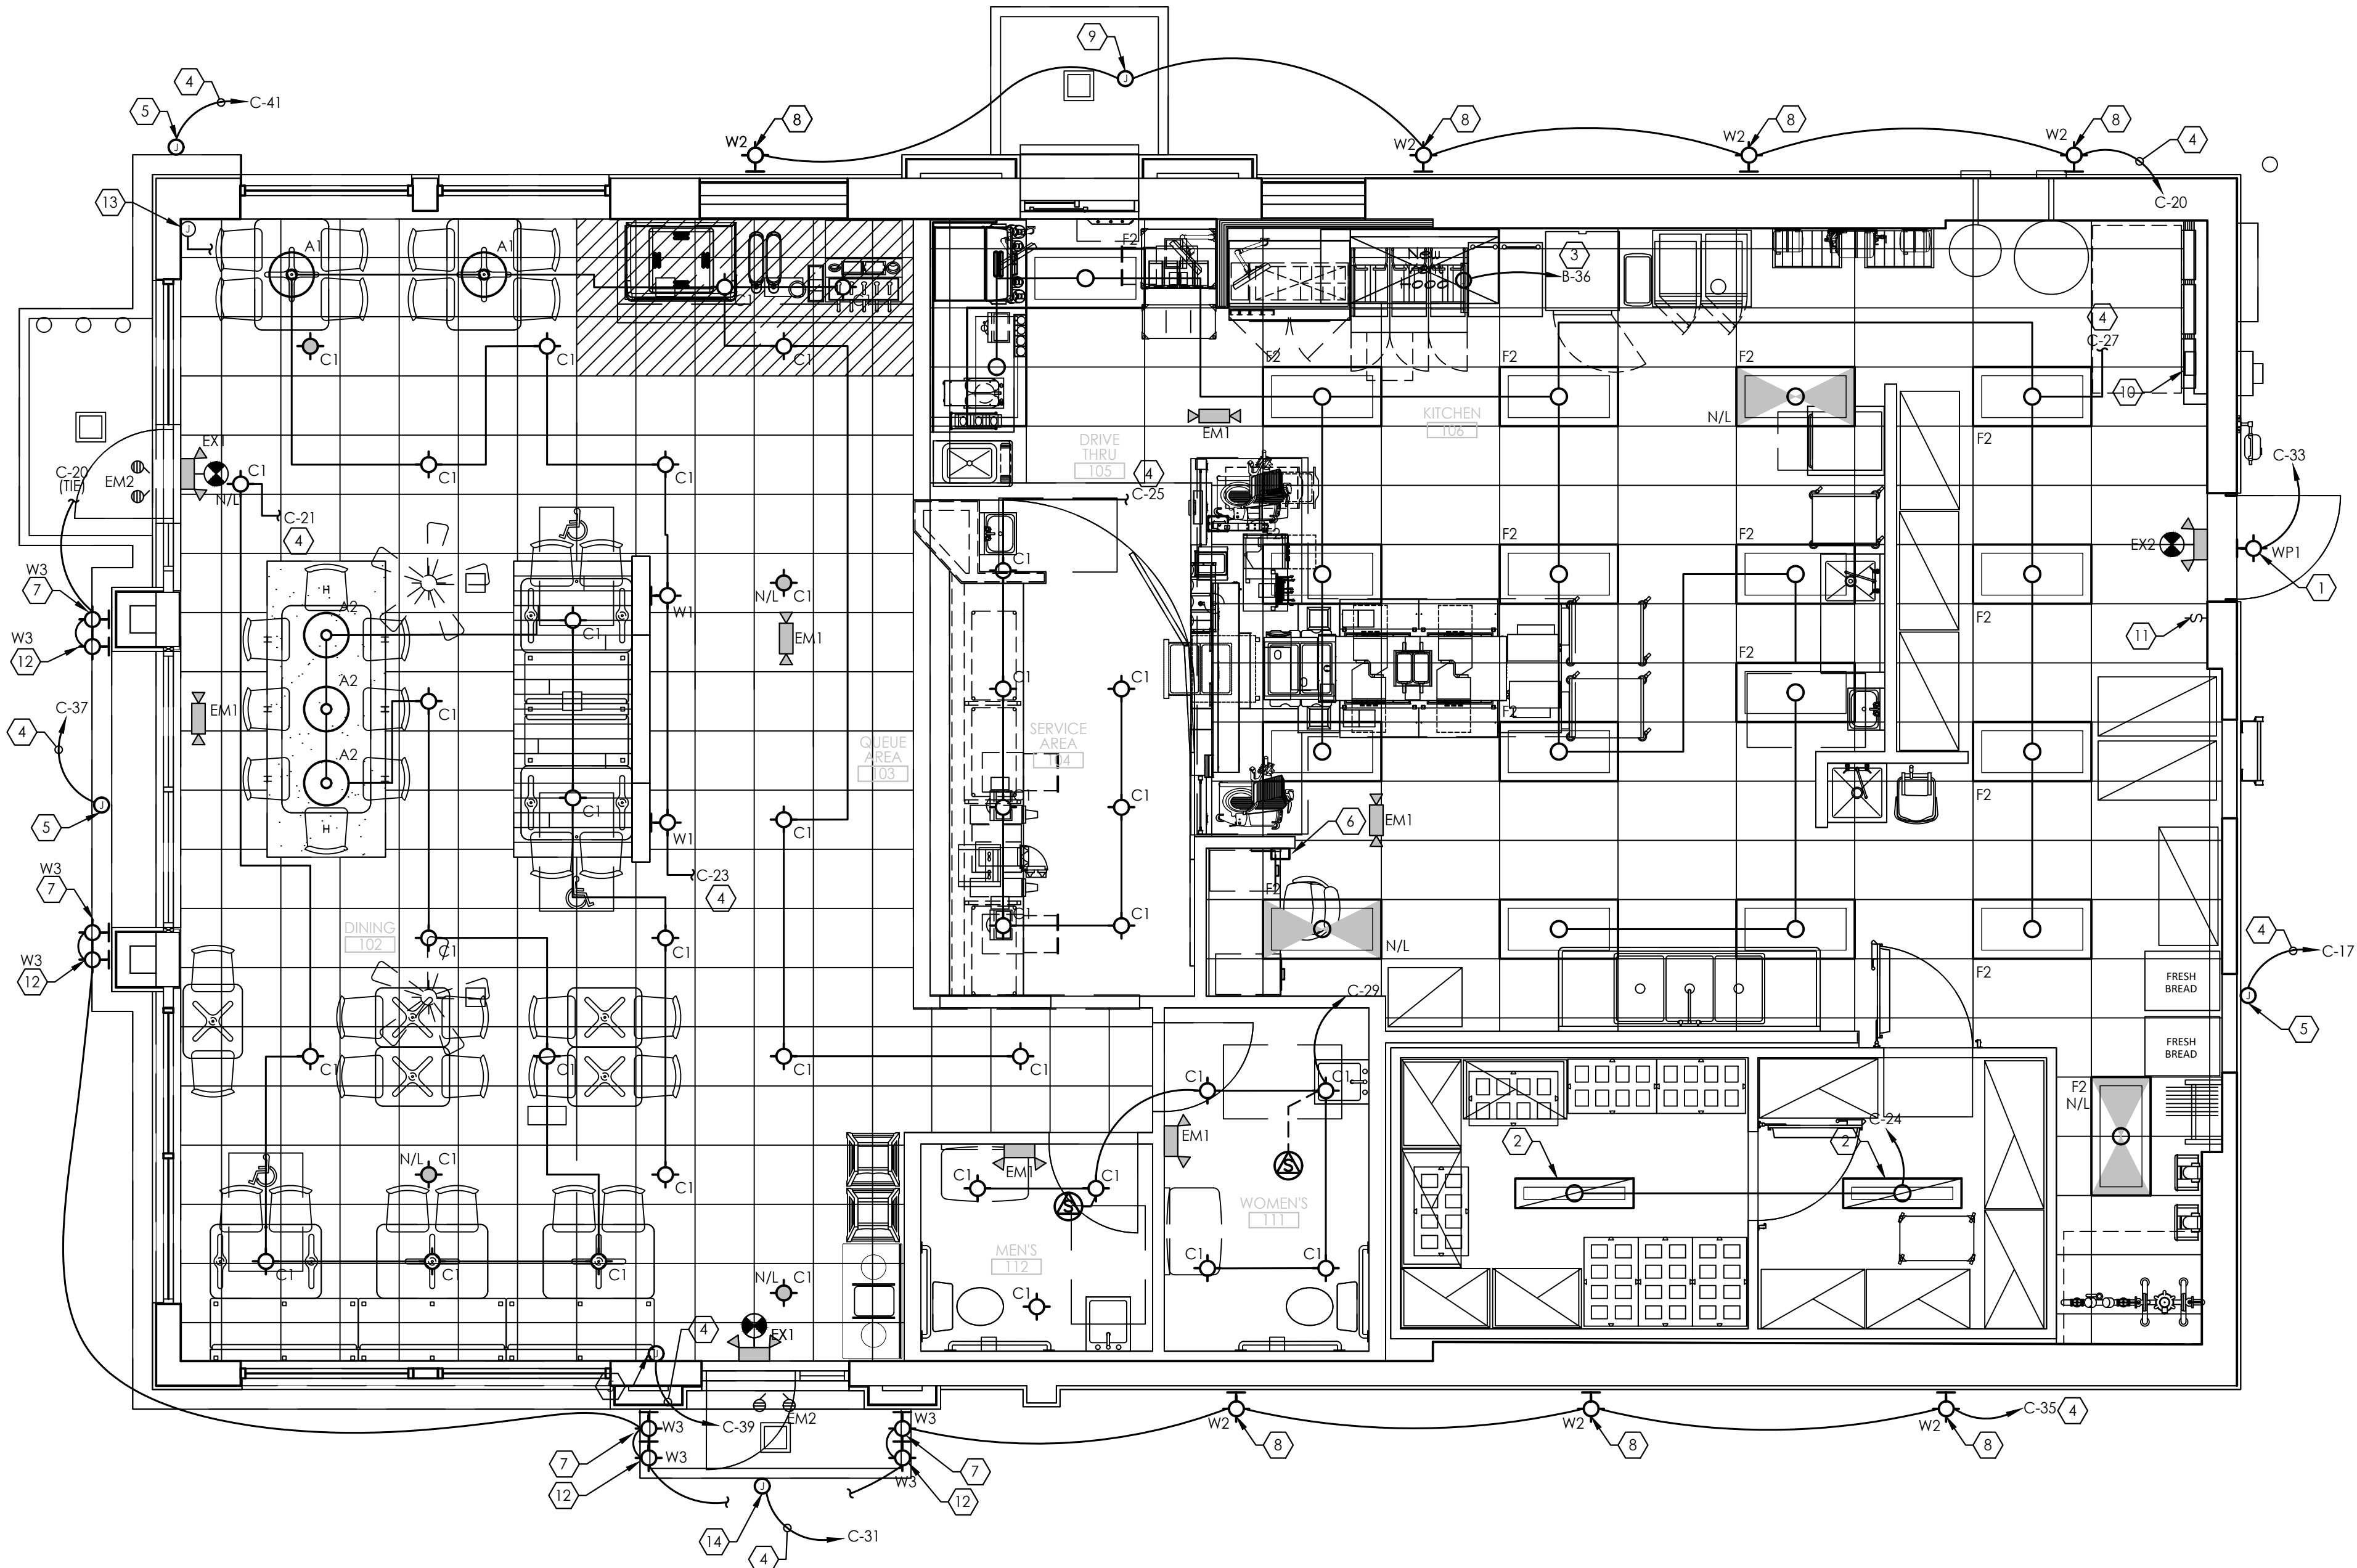

GENERAL NOTES:

- REFER TO REFLECTED CEILING PLAN FOR COORDINATION OF CEILING GRID, DIFFUSERS AND LIGHTING.
- ALL NIGHT LIGHTING, EXIT AND EGRESS EMERGENCY LIGHTING SHALL BE CONNECTED TO LOCAL LIGHTING CIRCUIT AHEAD OF SWITCH LEG.
- CONTRACTOR PROVIDE ALL MATERIALS TO PROVIDE A COMPLETE INSTALLATION IN ACCORDANCE WITH THE CURRENT EDITION OF THE NEC AND ALL STATE AND LOCAL CODES.
- REFER TO DECOR PLANS FOR COORDINATION OF ALL DECORATIVE PENDANT AND SCENCE LIGHTING, INCLUDING MOUNTING HEIGHTS AND SUSPENSION HEIGHTS & SPECIFICATIONS.
- MOUNT EXIT LIGHTS IN DINING ROOM ON BULKHEAD ABOVE DOOR.

CODING NOTES:

- MOUNT AT 8'-6" A.F.F. TO CENTER OF FIXTURE.
- EC SHALL MAKE FINAL CONNECTION TO FREEZER/COOLER LIGHTING PER MANUFACTURER'S RECOMMENDATIONS. FREEZER/COOLER LIGHTING SHALL BE FURNISHED BY FREEZER/COOLER MFRG AND INSTALLED BY GC.
- VAPOR PROOF LIGHT FIXTURES FURNISHED BY EXHAUST HOOD MANUFACTURER. EC SHALL INSTALL LIGHT FIXTURES PER MANUFACTURER'S RECOMMENDATION AND WIRE THRU EXHAUST HOOD CONTROLLER. SEE POWER PLAN. MAKE FINAL CONNECTION.
- THRU RELAY PANEL. SEE DETAIL AND SCHEDULE SHEET E4.1.
- EXTERIOR SIGN: PROVIDE WP JB AT 19'-0". DO NOT COMBINE OR SHARE NEUTRALS WITH OTHER CIRCUITS. IF SIGN IS NOT EQUIPPED WITH INTEGRAL DISCONNECT, PROVIDE WP DISC SW. COORDINATE WITH SIGN VENDOR. MOUNT JB INSIDE BUILDING IN TRUSS SPACE.
- DIGITAL SWITCH: ACUTY "CHELSEA" CH4-BWH-PWH
- MOUNT AT 12" A.F.F. TO CENTER OF FIXTURE. AIM FIXTURE UP.
- MOUNT AT 7'-6" A.F.F. TO CENTER OF FIXTURE.
- PROVIDE WP JB FOR CANOPY LIGHTING PROVIDED WITH CANOPY.
- RELAY PANEL: ACUTY "BLUE BOX LT" GR1416-LT-ENC-SMNE1-GR1416-LT-INT-8NOL-DTC-DV.
- DIGITAL SWITCH: ACUTY "CHELSEA" CH1-BWH-PWH.
- MOUNT AT 16'-4" A.F.F. TO CENTER OF FIXTURE.
- ARBY'S "A" SIGN: VERIFY EXACT LOCATION AND MOUNTING HEIGHT WITH ARBY'S CM PRIOR TO ROUGH-IN. EC SHALL WIRE "A" SIGN INTO LOCAL LIGHTING CIRCUIT FOR POWER. PROVIDE POWER THROUGH DIMMER SWITCH AT THE TOP OF THE "A". COORDINATE EXACT LOCATION OF DIMMER SWITCH WITH CM.
- EXTERIOR SIGN: PROVIDE WP JB IN BAND AT 11'-0". DO NOT COMBINE OR SHARE NEUTRALS WITH OTHER CIRCUITS. IF SIGN IS NOT EQUIPPED WITH INTEGRAL DISCONNECT PROVIDE DISC SW. COORDINATE WITH SIGN VENDOR.



PROPRIETARY INFORMATION NOTICE:  
THESE PROTOTYPICAL DOCUMENTS MAY REQUIRE REVISIONS TO CONFORM TO LOCAL, STATE, AND FEDERAL CODES, ORDINANCES OR OTHER CONDITIONS. THE DESIGN CONCEPTS EMBODIED IN THESE DOCUMENTS ARE SPECIFICALLY FOR THIS PROJECT. INFORMATION CONTAINED HEREIN REMAINS THE SOLE PROPERTY OF ARBY'S RESTAURANT GROUP, IS CONFIDENTIAL AND PROPRIETARY AND IS NOT TO BE COPIED, REPRODUCED, DISCLOSED OR OTHERWISE TRANSFERRED TO OTHER PARTIES IN ANY FORM WHATSOEVER WITHOUT THE EXPRESS WRITTEN CONSENT OF ARBY'S RESTAURANT GROUP.



Copyright 2020 by Arby's Restaurant Group

ARBY'S RESTAURANT GROUP  
INSPIRE DUAL REGULAR 40 - STANDARD  
1632 AR-25 BYPASS  
HEBER SPRINGS, AR 72543  
FOR  
RB AMERICAN GROUP, LLC  
6200 OAK TREE BLVD., SUITE 250, INDEPENDENCE, OHIO 44131

PROJECT NUMBER:

ISSUE	DATE
PRELIMINARY	
PERMIT	
BID	
REVISION	


LIGHTING PLAN  
ELECTRICAL

SHEET:

E1.1

2 TYPICAL OCCUPANCY SENSOR WIRING DIAGRAM

N.T.S.

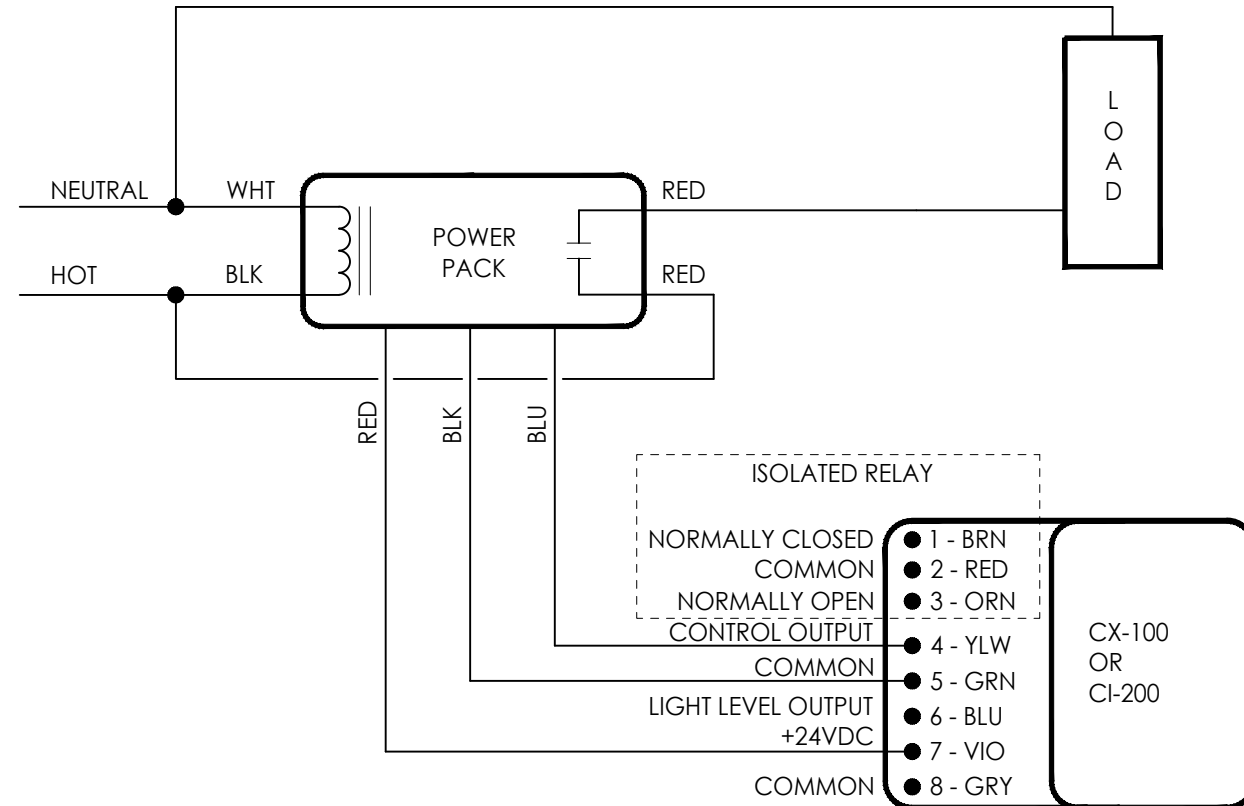

1 LIGHTING PLAN - ELECTRICAL

1/4" = 1'-0"